


TRANSFORMER RECTIFIERS

Selection guide

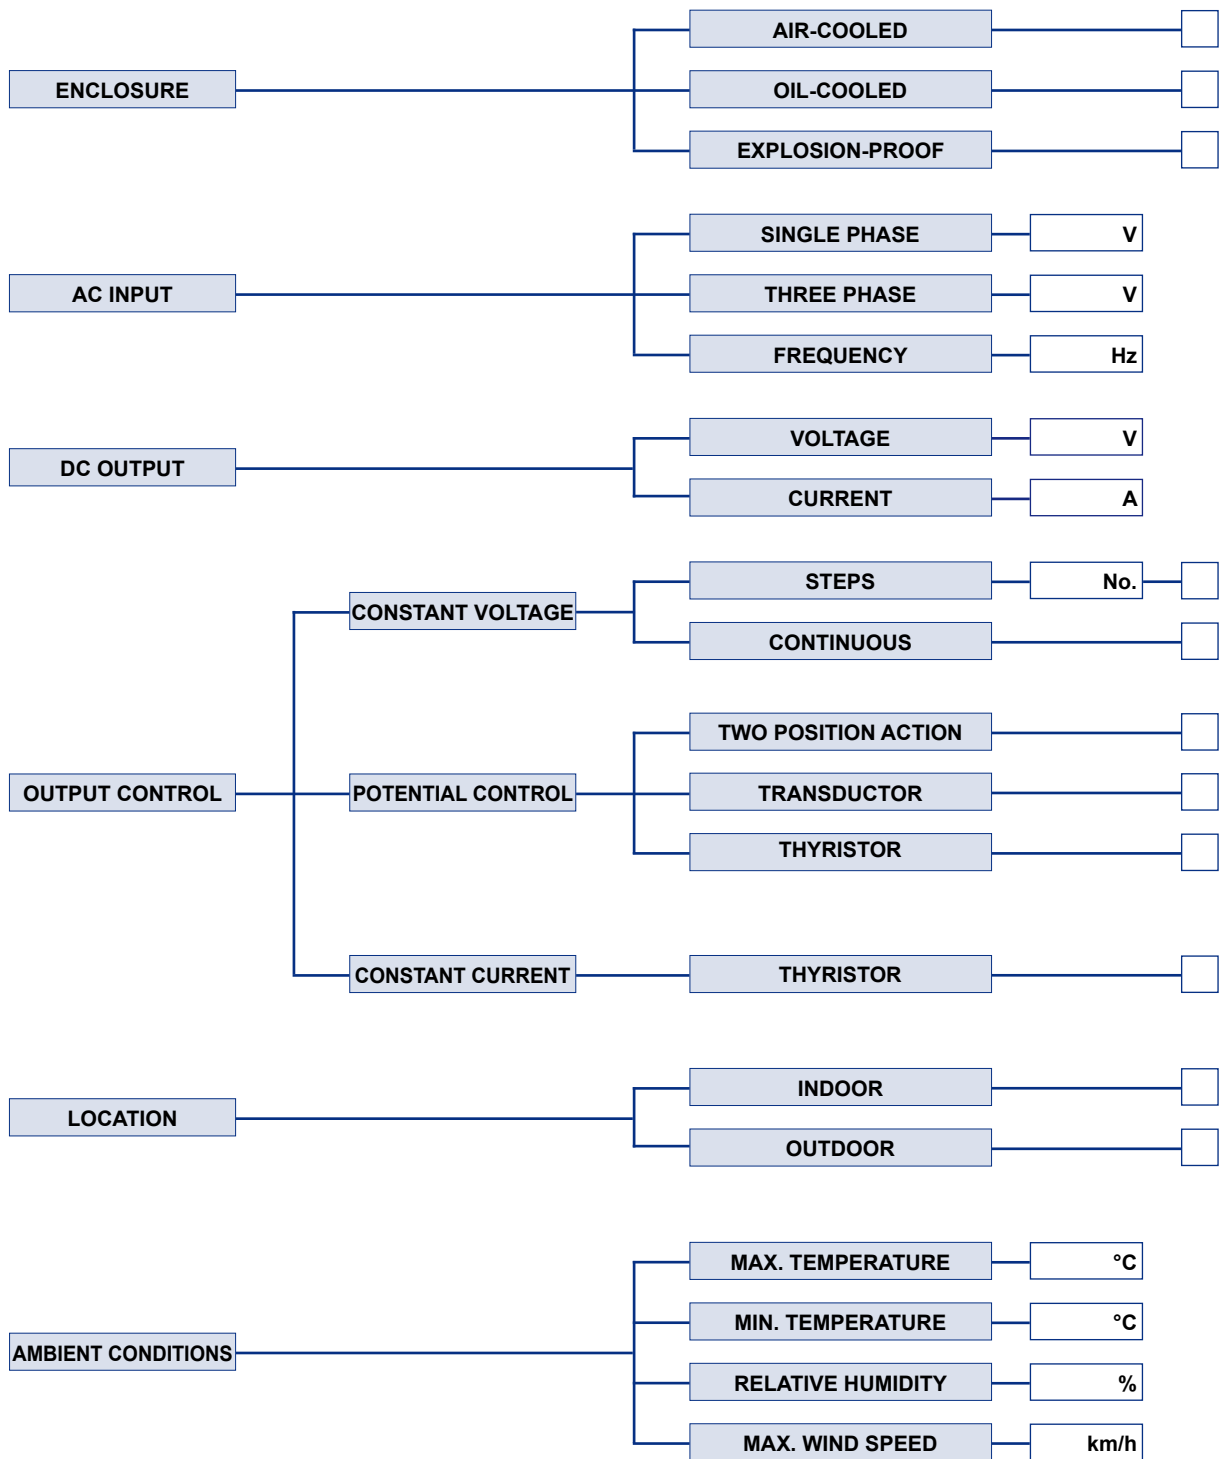

TRANSFORMER RECTIFIERS

Selection guide

AC VOLTMETER	_____	<input type="checkbox"/>
AC AMMETER	_____	<input type="checkbox"/>
DC VOLTMETER	_____	<input type="checkbox"/>
DC AMMETER	_____	<input type="checkbox"/>
POTENTIAL METER	_____	<input type="checkbox"/>
WORKING HOUR METER	_____	<input type="checkbox"/>
CURRENT INTERRUPTER	_____	<input type="checkbox"/>
	SYNCHRONISABLE	<input type="checkbox"/>
	NON SYNCHRONISABLE	<input type="checkbox"/>
POTENTIAL CONVERTER	_____	<input type="checkbox"/>
	Zn > Cu/CuSO ₄	<input type="checkbox"/>
	Ag/AgCl > Cu/CuSO ₄	<input type="checkbox"/>
	MnO ₂ > Cu/CuSO ₄	<input type="checkbox"/>
LIGHTNING ARRESTER	_____	<input type="checkbox"/>
WITHSTAND H.V. UP TO 3 kV AC	_____	<input type="checkbox"/>
REMOTE MONITORING	_____	<input type="checkbox"/>
	FAILURE ALARM	<input type="checkbox"/>
	POTENTIAL	<input type="checkbox"/>
	DC OUTPUT	<input type="checkbox"/>
CURRENT LIMITATION	_____	<input type="checkbox"/>
BASE CURRENT SETTING	_____	<input type="checkbox"/>

Other Requirements

